




## Water Cooled Units Technical Data

HWP 36, 48, 59, 79, 98, 118, 142, 172, 192, 255, 275



Cooling Capacity  
3.5kW - 27.5kW

Heating Capacity  
3.6kW - 24.6kW

# Water Cooled air conditioners

## Contents




<b>HWP 36–275 SERIES</b>		<b>SAT-3 CONTROLLER (Optional)</b>	
Introduction	4	Features Summary	9
Features	5	<b>PERFORMANCE DATA</b>	
Refrigerant R410A	5	Cooling Capacity (kW)	10
Efficient	5	Reverse Cycle Systems / Heating Capacity (kW)	12
ThermoShell Technology	5	Air Handling	14
Performance	5	Water Flow vs Water Pressure	16
Durable	5	Sound Levels	17
Quiet	5	Supply Air Outlet	17
Safety	5	Supply Air Outlet + Insulated Duct	19
Insulation	5	Case Breakout + Return Air	21
Control Options	5	Sound Pressure Levels (SPL) Within A Room	23
Self Diagnostics	6	Recommendations for Noise Isolation	23
Peace of Mind	6	<b>DIMENSIONS (mm)</b>	
Electric Heating	6	HWP 36–98	24
Accessories	6	HWP 118–275	25
Installation	6	<b>SPECIFICATIONS</b>	
Optional Equipment	6		26
Water Connection	7		
Technical Support	8		
Safety Features	7		
Electrical	7		
Nomenclature	8		
Technical Support	8		

# Water Cooled air conditioners

HWP 36–275 series



The HWP units provide a choice of cooling only or reverse cycle (heat pump) packaged system air conditioners designed and developed to comply with and exceed AS/NZS 3823.

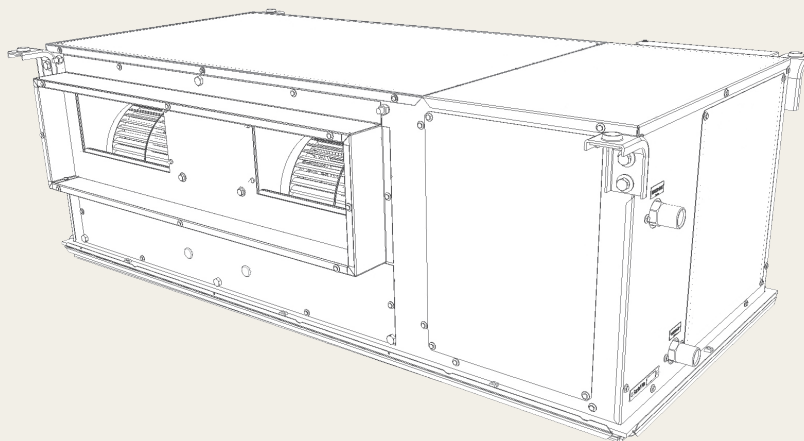

# Water Cooled air conditioners

## HWP 36–275 series



### Applications

The HWP-K units are ideal for multi-unit installations such as high-rise office, apartments or hotel buildings, where the flexibility of individual zone control is required.

## INTRODUCTION

The temperzone HWP-K Series represents a range of ducted, water sourced, packaged air conditioners designed to provide year round comfort to room occupiers.

Compact and reliable, these units can be installed above ceilings/corridors, or in other concealed spaces, saving valuable floor space and providing conditioned air direct to necessary locations.

HWP-K Series units are designed to be used with simple duct layouts. To take maximum advantage of this feature, units should be located as close to the space to be air conditioned as acoustic criteria allows. Multiple small units, utilizing minimal duct lengths, prove more economical than a single large central ducted unit.

Designed also to suit different climates, the HWP-K units are available in three versions:

1. Reverse Cycle (R)  
ie Heat Pump / Cooling & Heating
2. Cooling Only with Electric Heat (CE)
3. Cooling Only (C) – not available in Australia

The standard unit is right handed, i.e. when facing the discharge side of the unit, the water connections are on the right hand side of the unit. Opposite Hand versions are also available.

In office buildings, an HWP unit system can provide the ideal off-peak system for occupied areas when the main system is not running, e.g. night time, weekends, holidays.

HWP unit systems can be applied to provide owner occupiers with individual control and billing, thus avoiding large central plant room areas, e.g. in apartment buildings.

Installing multiple reverse cycle versions enables simultaneous heating and cooling in different parts of a building.

Multiple HWP units are typically part of an overall hydronic system that incorporates some form of heat rejection equipment – usually a cooling tower or dry air cooler (radiator).

# Water Cooled air conditioners

## HWP 36–275 series



### FEATURES

#### Refrigerant R410A

Each unit is factory charged with refrigerant R410A, which has a zero ozone depletion potential.

#### Efficient

These air conditioners provide one of the most efficient forms of cooling and/or heating you can invest in, as evidenced by their high EER figures. Each unit incorporates a high efficiency scroll compressor. Heat exchange air coils use inner grooved (rifled) tube for better heat transfer.

#### ThermoShell® Technology

The unit includes a compact long life highly efficient water heat exchanger design with non-fouling properties.

#### Performance

The fan speed can be stepped (ie High/Med/Low) to match the supply air requirements.

#### Durable

Temperzone units have a tough galvanised steel construction. The air coil is die formed plate type epoxy coated aluminium fins mechanically bonded to high efficiency inner grooved copper tubes. Each HWP unit alone (excluding hoses) will withstand a maximum water pressure of 3200 kPa (464 psi). Condensate drain trays are insulated and powder coated for complete moisture protection. The drain tray is easily removed for inspection and cleaning.

#### Quiet

HWP units have bonded polyester lined compressor and fan compartments to minimise noise. Spring mounting kits are supplied with every unit to minimise the transfer of any vibration.

#### Safety

Units are fitted with a high pressure lockout that protects the unit in the event of water flow failure in cooling mode. Sensors protect against low air coil temperature and loss of refrigerant. Units include an anti-rapid cycle timer for compressor on/off protection.

HWP reverse cycle units also have a low refrigerant pressure sensor to protect against icing-up of the water within the unit's ThermoShell® condenser on heating mode and a water pump flow verification input to protect individual units from a loss of water flow.

Convenient lockout contactor resetting is simply achieved by turning the power to the unit off and then on again, avoiding the need to gain access to each unit if the cause is failure of central water supply.

Each compressor has internal overload protection.

The HWP reverse cycle version has a low refrigerant pressure limit and a reverse cycle change-over valve.

#### Insulation

Closed cell foam insulation has been used to inhibit mould growth in places where moisture could be present and provide thermal protection, eg to minimise cold tracking. Bonded polyester insulation ensures no particles are introduced into the air stream.

Insulation is foil faced and meets fire test standards AS 1530.3 (1999) and BS 476 parts 6 & 7.

#### Control Options

The unit's UC8 Controller can be connected to Temperzone's SAT-3, TZT-100 or other compatible room temperature controllers supplied by others. It is BMS compatible via Modbus/RS485 port with multi-unit control possible – either via digital and analogue signals or via Modbus. The UC8 can activate the water circulating pump (only when required) and/or a local water on/off valve, thus saving pump running costs. It can also control the position of a motorised water regulating valve (using 0–10V signal), so that head pressure control can be achieved and lower water temperatures can be used on cooling mode.

# Water Cooled air conditioners

## HWP 36–275 series



### Self Diagnostics

Any faults detected are displayed on the UC8 and optional SAT-3 Wall plaque. General fault and run status output signals are available for remote indication to building management systems.

### Peace of Mind

Temperzone operates a quality management system that conforms to AS/NZS ISO 9001:2008. The company's products have been selected, against worldwide competition, for use in some of the most exclusive projects – chosen because of their proven efficiency, durability, performance, reliability and value.

### Electric Heating

(HWP-CE model)

Electric element/s have spiral wound stainless steel fins to give increased area and low surface temperature. They are totally enclosed within the unit and are supplied with auto (90°C) and manual (120°C) high temp. safety thermostats required to meet AS/NZS 60335.2.40 2006. A fan run-on timer for rapid heat dissipation is incorporated into the UC8 as well as a 70° fast acting temperature sensor to ensure overall safety.

## ACCESSORIES (SUPPLIED)

### Air Filter

Each unit is supplied with a washable synthetic fibre EU2/G2 rated filter that is integrated with the return air spigot. This filter complies with AS/NZS 1324.1:2001.

For ducted return air applications, filters should ideally be located in the ceiling return air grille/s and removed from the HWP unit's return air spigot, thereby improving access for cleaning.

### Flexible Hoses

The HWP is supplied with two high pressure hoses (HWP 36–142: 600 mm long; HWP 172–275: 800 mm long) for water connections. The hoses have female pipe threaded nut fittings at both ends. Maximum water pressure for 600 length is 1720 kPa (250 psi); 800 length is 2070 kPa (300psi).

### Spring Mounting Kit

The HWP Series Spring Mounting System, supplied with each unit, has been designed to minimise the transfer of vibration from the HWP unit into the building structure. Recommended for use in all installations.

### Return Air Temperature Sensor

An optional use pre-mounted return air sensor is supplied with each unit. This is compatible with SAT-3 Controllers; no additional wiring required. An additional lead would be required if a TZT-100 Controller was to utilise this sensor.

## OPTIONAL EQUIPMENT

1. temperzone SAT-3 Controller or TZT-100 Controller – connection cables supplied separately.
2. Condensate -Lift Pump – max. lift 800mm.

## INSTALLATION

### Acoustics


Shorter duct applications will require greater attention to acoustic criteria (refer page 15).

### Mounting

It is recommended that HWP units be mounted using the spring mounting system supplied. This system minimises transfer of vibration into the building structure.

### Positioning

When determining the installation location consideration should be

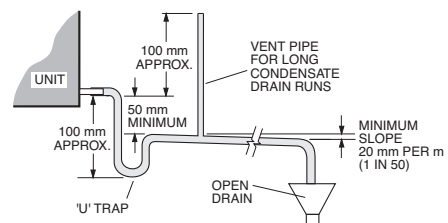

given to each unit to facilitate future servicing and maintenance, e.g. room for removal of filter and access to electrics.

### Condensate Drain

The condensate drain should have a slope of at least 1 in 50 and must not be piped to a level above the unit drain tray.

Condensate drain traps are required on the larger models, i.e. HWP 79–275.

An optional condensate lift-pump is available to remove condensate from the unit in tight installations where a well sloped drain line is not practical.

# Water Cooled air conditioners

## HWP 36–275 series



### WATER CONNECTION

#### General

The HWP unit's IN and OUT water connections are male pipe threaded. The unit can be piped directly or by using two temperzone flexible high pressure water hoses (supplied) which have female pipe threaded connections at each end.

Poor quality water supply must be pre-filtered and it is essential that adequate water treatment is maintained, particularly where open cooling towers are used.

Note: It is recommended that the water supply system be fitted with a water flow switch and water flow verification circuit. These items prevent the HWP units from going into fail safe lockout status due to a loss of water flow. Failure to install the above items could require the resetting of all HWP units in the system – by breaking the power supply to each unit or by Modbus command.

#### Circuit Balancing Valve

It is recommended that a circuit balancing valve be fitted to maintain water flow at a constant rate. The water flow rates in litres per second (l/s), at nominal water temperature, are stated in the Specifications Table (pages 26,27). The water circuit needs to be balanced to suit the design  $\Delta T$  of the central water system.

The HWP unit controller will protect the refrigeration system of the unit under extreme conditions. On heating cycle it protects to ensure the evaporating temperature does not drop below freezing point for an extended period. **It is important that the leaving water temperature does not fall be low 4°C.** The entering water temperature will determine how low the water flow can be allowed to go without causing nuisance trips from this protection. Refer page 14 for flow data.

#### Water Circulating Pump & Flow Verification Option

In order to promote efficiency and avoid running the water circulation pump unnecessarily, the unit's UC8 Controller can be used to control the activation of the pump prior to running the compressor. After activation of the circulating pump contactor (not part of the HWP unit), the UC8 waits for the pump flow verification relay contact (PFVR) to close before energising the compressor contactor (CMC) and therefore starting the compressor (refer wiring diagram). The UC8 also de-activates the pump when the compressor stops.

#### Water Control Options

System designers have one of two options:

##### 1. Water Regulating Valve Control Option

A 0-10V signal is available on output V1 for the control of a water flow control valve (optional; not supplied by temperzone); refer wiring diagram. When used, the valve is closed (0V signal) when the compressor is off. When the unit is cooling the signal will control the valve to obtain an optimum condensing temperature. When the unit is heating (reverse cycle units) the valve is directed fully open (10V signal).

OR

##### 2. Water Shut-Off Valve Option

This will ensure the water is not flowing through the unit when it is not operational for a long period of time, thereby reducing the overall central pump power usage. The water shut-off relay on the HWP can be used to activate a water shut-off valve (supplied and fitted by others).

### SAFETY FEATURES

1. HP and loss of refrigerant protection.
2. Anti-rapid cycle timer and internal overload for compressor protection.
3. Circuit breaker control circuits.
4. Electronic pressure control prevents icing up of the Thermoshell® heat exchanger during heating cycle.
5. Frost protection on cooling cycle.
6. Sensor fault indication.
7. Compressor minimum run time to ensure oil return.

### ELECTRICAL

The electrical supply required (including voltage fluctuation limits) is:

#### HWP 36/48/59/79/98:

1 phase 230 V a.c. 50 Hz with neutral and earth.

#### HWP 118/142/172/192/255/275:

3 phase 400 V a.c. 50 Hz with neutral and earth.

All units are compliant to the latest MEP standards.

# Water Cooled air conditioners

## HWP 36–275 series



### NOMENCLATURE

Example

<b>H</b>	<b>W</b>	<b>P</b>	<b>7</b>	<b>9</b>	<b>C</b>	<b>E</b>	<b>K</b>	<b>S</b>
Series			Size		Type			
H - Hideaway W - Water Sourced P - Packaged			Divide by 10 to get approx. nominal Capacity in kilowatts		C - Cooling only CE - Cooling only with electric heat R - Reverse cycle K - Refrigerant R410A S - Single phase power supply			


### TECHNICAL SUPPORT

For more information on the manufacturer or product support information, visit the website [www.temperzone.biz](http://www.temperzone.biz)



# Water Cooled air conditioners

## SAT-3 Controller (Optional)

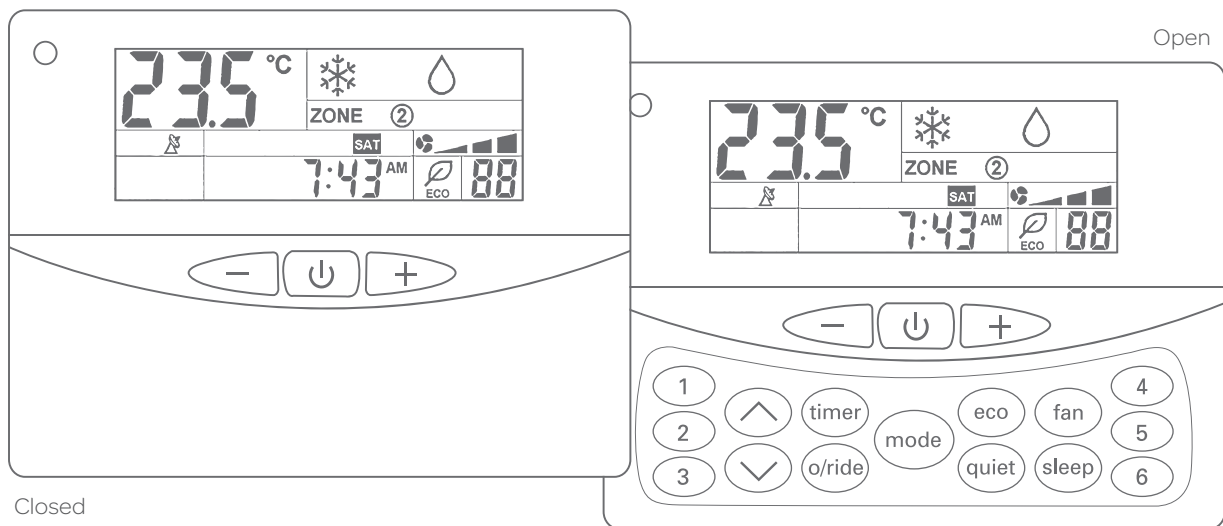

### FEATURES SUMMARY

- Cool / Cool Dry / Heat / Auto Dry / Auto / Fan Only modes.
- Auto / High / Medium / Low fan speed selection. (customisable).
- Temperature setting range from 16°C – 30°C.
- LED to indicate status of the unit [Power On/Off].
- Room temperature display.
- Real time clock.
- **7 day timer** – up to two events (four start and/or stops per day)
- On demand countdown run timer, up to 9 hours.
- Auto-Restart or No Restart after power failure.
- Continuous or Intermittent selection of fan run-on in dead zone.
- Backlit screen for ease of reading; changes colour for each mode.
- Soft touch tab keys
- Battery backup (Lithium).
- **Sleep function** – improves night time comfort and saves energy.
- Audible beep to acknowledge key entry or wireless remote control.
- Low voltage control cable.
- **Colour:** white and light grey (Keypad – green and blue).

#### Optional:

Remote return air sensor

**Note:** Not backwards compatible with units using SAT-2.

#### TZT-100:

Refer [www.temperzone.biz](http://www.temperzone.biz) for information.





# Water Cooled air conditioners

## Performance Data - Reverse Cycle Systems



### HEATING CAPACITY (KW)

HC = Heating Capacity (kW) \*

HAb = Heat Absorbed (kW)

○ = Nominal Capacity (kW).

EWT = Entering Water Temperature (°C) (Minimum required 10°C)

INPT = Compressor Input (kW)

E.A.T. = Entering Air Temperature (°C)

Model	Water Flow Rate l/s	Coil E.A.T. D.B. °C	Leaving water temperature (LWT) °C											
			12.5				15.5				18.5			
			HC	HAb.	EWT	INPT	HC	HAb.	EWT	INPT	HC	HAb.	EWT	INPT
HWP 36	0.22	18	3.5	2.6	15.4	0.9	3.7	2.8	18.6	0.9	4.0	3.0	21.8	0.9
		21	3.4	2.5	15.3	0.9	3.7	2.7	18.5	1.0	4.0	3.0	21.8	1.0
		25	3.4	2.4	15.2	1.0	3.7	2.7	18.4	1.0	3.9	2.9	21.7	1.1
HWP 48	0.28	18	4.4	3.3	15.3	1.1	4.7	3.6	18.6	1.1	5.0	3.8	21.8	1.2
		21	4.3	3.2	15.3	1.1	4.6	3.5	18.5	1.2	5.0	3.8	21.7	1.2
		25	4.3	3.1	15.2	1.2	4.6	3.4	18.4	1.3	5.0	3.6	21.6	1.3
HWP 59	0.34	18	5.2	3.7	15.1	1.5	5.5	4.0	18.3	1.6	5.9	4.3	21.5	1.6
		21	5.1	3.6	15.0	1.6	5.4	3.8	18.2	1.7	5.9	4.2	21.5	1.7
		25	5.1	3.4	14.9	1.7	5.4	3.7	18.1	1.8	5.9	4.0	21.3	1.9
HWP 79	0.50	18	8.4	6.5	15.6	1.9	9.0	7.1	18.9	2.0	9.7	7.6	22.1	2.1
		21	8.4	6.4	15.5	2.0	8.9	6.9	18.8	2.1	9.7	7.5	22.1	2.2
		25	8.4	6.2	15.5	2.2	8.9	6.7	18.7	2.3	9.6	7.2	22.0	2.4
HWP 98	0.61	18	10.6	8.2	15.7	2.4	11.3	8.9	18.9	2.4	12.2	9.6	22.2	2.6
		21	10.5	8.0	15.6	2.5	11.3	8.7	18.8	2.6	12.1	9.4	22.1	2.7
		25	10.5	7.8	15.5	2.7	11.3	8.5	18.8	2.8	12.1	9.1	22.0	2.9

# Water Cooled air conditioners

## Performance Data - Reverse Cycle Systems



### HEATING CAPACITY (KW)

HC = Heating Capacity (kW) \*

HAb = Heat Absorbed (kW)

○ = Nominal Capacity (kW).

EWT = Entering Water Temperature (°C) (Minimum required 10°C)

INPT = Compressor Input (kW)

E.A.T. = Entering Air Temperature (°C)

Model	Water Flow Rate l/s	Coil E.A.T. D.B. °C	Leaving water temperature (LWT) °C											
			12.5				15.5				18.5			
			H	HAb.	EWT	INPT	H	HAb.	EWT	INPT	H	HAb.	EWT	INPT
HWP 118	0.75	18	10.9	8.0	15.1	2.9	11.7	8.7	18.3	3.0	12.5	9.4	21.5	3.2
		21	10.8	7.8	15.0	3.1	11.6	8.4	18.2	3.2	12.5	9.1	21.4	3.4
		25	10.8	7.5	14.9	3.3	11.6	8.2	18.1	3.5	12.4	8.8	21.3	3.6
HWP 142	0.88	18	14.1	10.8	15.4	3.3	15.1	11.7	18.0	3.4	18.0	13.6	21.5	4.4
		21	14.0	10.6	15.4	3.5	14.5	11.4	18.0	3.7	16.2	12.4	21.9	3.8
		25	14.0	10.2	15.3	3.8	14.5	11.1	18.5	3.9	16.1	12.0	21.8	4.1
HWP 172	1.06	18	15.7	11.6	15.0	4.1	16.8	12.6	18.2	4.2	18.0	13.3	21.5	4.4
		21	15.6	11.3	15.0	4.3	16.7	12.2	18.1	4.2	18.0	13.6	21.4	4.7
		25	15.5	10.9	14.9	4.6	16.7	11.8	18.1	4.5	17.9	13.3	21.3	5.1
HWP 192	1.26	18	17.4	12.6	14.9	4.9	18.7	13.6	18.1	4.9	20.0	12.8	21.3	5.3
		21	17.3	12.2	14.8	5.1	18.6	13.2	18.0	5.4	20.0	14.3	21.2	5.6
		25	17.3	11.7	14.7	5.6	18.6	12.7	17.9	5.8	19.8	13.8	21.1	6.1
HWP 255	1.53	18	21.5	16.5	15.1	4.9	23.0	17.9	18.3	5.1	24.7	19.3	21.5	5.4
		21	21.3	16.1	15.0	5.2	23.0	17.4	18.2	5.4	24.6	18.9	21.5	5.7
		25	21.2	15.6	14.9	5.6	22.8	17.0	18.2	5.9	24.4	18.3	21.4	6.1
HWP 275	1.63	18	23.0	17.2	15.0	5.9	24.7	18.6	18.2	6.1	26.5	20.1	21.4	6.4
		21	22.9	16.7	14.9	6.2	24.5	18.0	18.1	6.5	26.4	19.6	21.4	6.8
		25	22.8	16.1	14.9	6.7	24.5	17.5	18.1	7.0	26.2	18.9	21.3	7.3

# Water Cooled air conditioners


## Performance Data




### AIR HANDLING

Airflows are for a dry coil. Reduce airflow by 10% in high moisture removal conditions. In a free blow application, beware of exceeding fan motor's full load amp limit. Refer page 13 for filter losses. **Air flows given are for HWP units without filter installed.**


#### HWP 36

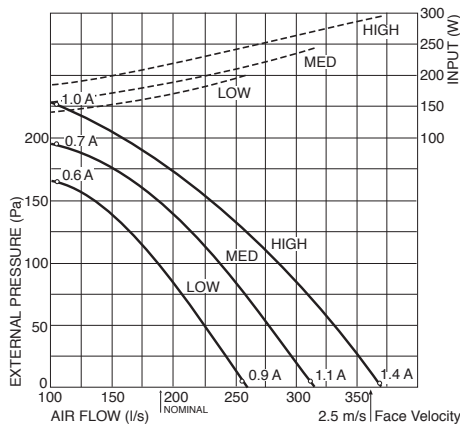


#### HWP 48

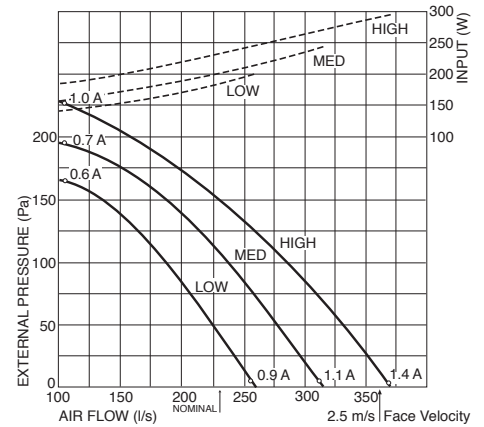


#### HWP 59

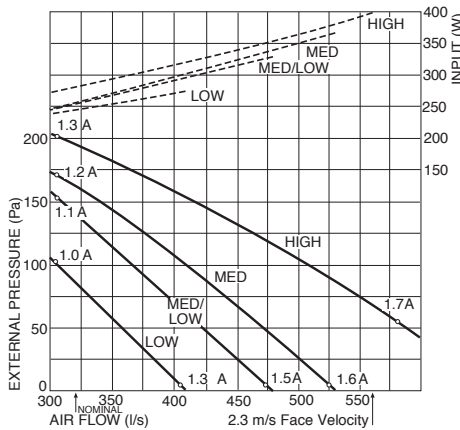


#### HWP 79

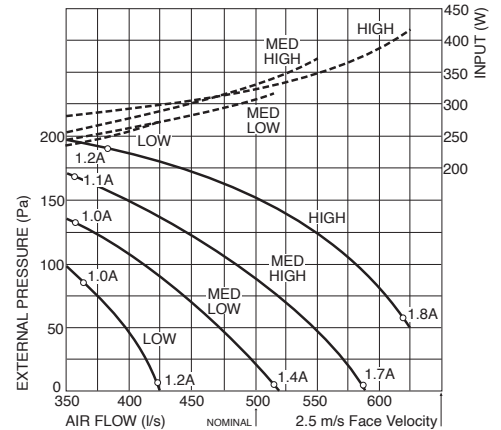

#### HWP 98

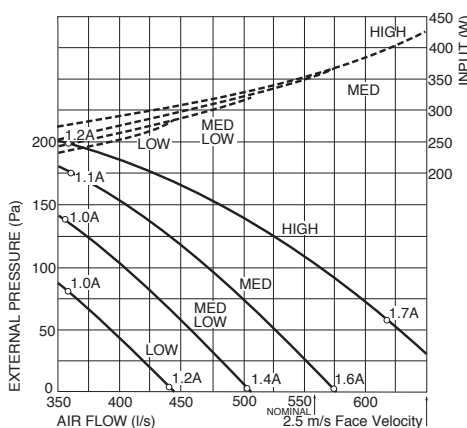

#### HWP 118

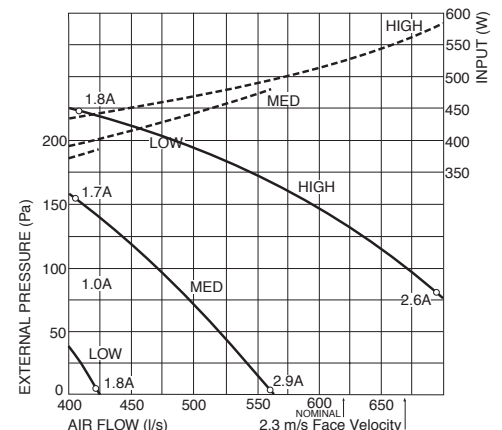

# Water Cooled air conditioners


## Performance Data




### AIR HANDLING (CONT'D)

Airflows are for a dry coil. Reduce airflow by 10% in high moisture removal conditions. In a free blow application, beware of exceeding fan motor's full load amp limit. Refer table below for filter losses. **Air flows given are for HWP units without filter installed.**


#### HWP 142

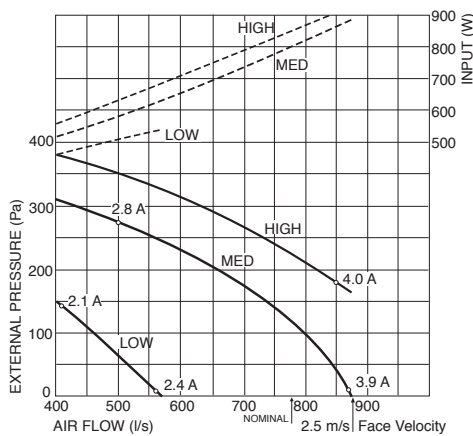


#### HWP 172

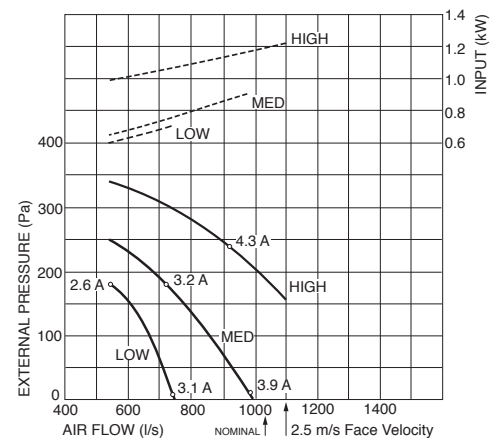


#### HWP 192

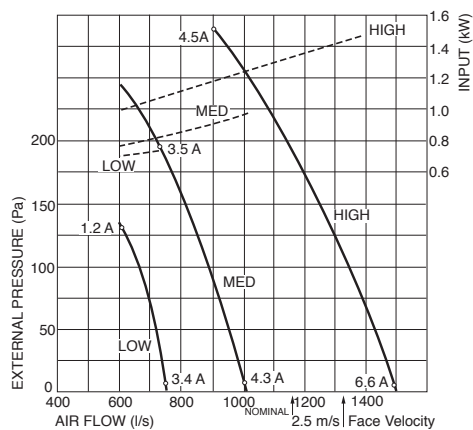

#### HWP 255

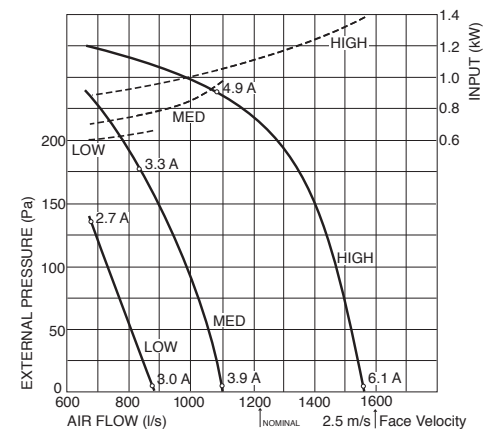

#### HWP 275

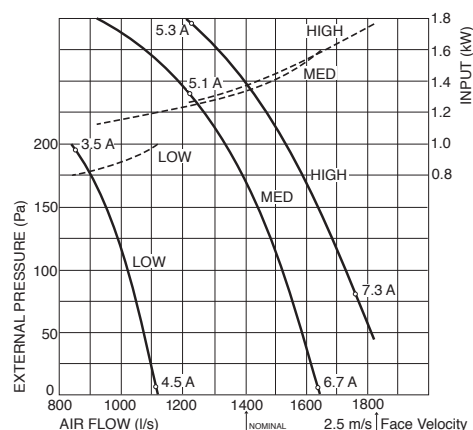

#### Note

1. In tropical (high humidity) conditions care must be taken to select an air flow which gives a suitable coil face air velocity, to prevent water carry over.
2. Applications using high proportions of fresh air should be referred to temperzone engineering office to establish the correct selection of units.

#### Pressure Drop - EU2/G2 rated filter media (clean):

Coil Face Velocity (m/s)	1.5	2.0	2.5
Pressure Loss (Pa)	15	25	40

# Water Cooled air conditioners

## Performance Data



### WATER FLOW VS PRESSURE DROP

The chart below shows Water Flows and Pressure Drop at varying water temperature differences.

Nominal water flow is at a Water Temperature difference of 5K. The reduced water flows shown below have minimal effect on performance.

Model:	HWP36		HWP48		HWP59		HWP79		HWP98	
THR	4.4		5.6		7.6		10.2		12.5	
Water Temp Difference K	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa
5.0	0.22	27.6	0.28	27.6	0.34	41.0	0.50	70.0	0.61	41.0
5.5	0.19	20.9	0.24	22.8	0.33	38.8	0.44	55.1	0.54	28.7
6.0	0.18	17.6	0.22	19.2	0.30	32.6	0.41	46.3	0.50	24.1
6.5	0.16	15.0	0.21	16.3	0.28	27.8	0.38	39.5	0.46	20.5
7.0	0.15	12.9	0.19	14.1	0.26	23.9	0.35	34.0	0.43	17.7
7.5	0.14	11.2	0.18	12.3	0.24	20.8	0.33	29.6	0.40	15.4
Min. water flow	0.06	2.1	0.07	7.5	0.09	2.9	0.14	5.5	0.18	3.1

Model:	HWP118		HWP142		HWP172		HWP192		HWP255		HWP275	
THR	15.4		18.4		23.0		26.5		31.5		34.3	
Water Temp Difference K	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa	Water Flow l/s	Press Drop kPa
5.0	0.75	55.0	0.88	69.0	1.06	83.0	1.26	34.0	1.53	48.00	1.63	55.00
5.5	0.67	43.9	0.80	57.1	1.00	74.0	1.16	28.5	1.40	40.48	1.49	46.25
6.0	0.61	36.9	0.73	48.0	0.92	62.1	1.06	24.1	1.28	34.01	1.37	38.86
6.5	0.57	31.4	0.68	40.9	0.85	53.0	0.98	20.5	1.19	28.98	1.26	33.11
7.0	0.53	27.1	0.63	35.2	0.79	45.6	0.91	17.7	1.10	24.99	1.17	28.55
7.5	0.49	23.6	0.59	30.7	0.73	39.8	0.85	15.4	1.03	21.77	1.09	24.87
Min. water flow	0.21	4.3	0.24	5.1	0.30	6.7	0.35	2.6	0.42	3.82	0.46	4.40

**THR = Total Heat Rejection (kW)**



# Water Cooled air conditioners

## Performance Data



### SOUND LEVELS

**Test Conditions:**

SWL measured to BS 848 PT2:1985. Installation Type A (free inlet and outlet). Direct method of measurement (reverberant room).  
Measured in decibels re 1 picowatt.

### Sound Power Levels (SWL)

SPL measured 1m from source in an anechoic chamber.

### SUPPLY AIR OUTLET

Model	FAN SPEED	SOUND PRESSURE LEVEL SPL dB(A)	SOUND POWER LEVEL SWL dB(A)	OCTAVE BAND FREQUENCY Hz					
				125	250	500	1K	2K	4K
SOUND POWER LEVELS (SWL) dB									
HWP 36	HIGH	50	<b>61</b>	64	62	56	56	53	49
	MED	47	<b>58</b>	62	58	54	53	49	46
	LOW	43	<b>54</b>	59	55	50	49	45	42
HWP 48	HIGH	50	<b>61</b>	64	62	56	56	53	49
	MED	47	<b>58</b>	62	58	54	53	49	46
	LOW	43	<b>54</b>	59	55	50	49	45	42
HWP 59	HIGH	55	<b>66</b>	67	63	62	61	59	54
	MED	52	<b>63</b>	66	61	59	59	56	50
	MED/LOW	50	<b>61</b>	64	58	57	57	54	48
	LOW	47	<b>58</b>	63	56	54	54	51	45
HWP 79	HIGH	55	<b>66</b>	67	63	62	61	59	54
	MED	52	<b>63</b>	66	61	59	59	56	50
	MED/LOW	50	<b>61</b>	64	58	57	57	54	48
	LOW	47	<b>58</b>	63	56	54	54	51	45
HWP 98	HIGH	55	<b>66</b>	67	63	62	61	59	54
	MED	52	<b>63</b>	66	61	59	59	56	50
	MED/LOW	50	<b>61</b>	64	58	57	57	54	48
	LOW	47	<b>58</b>	63	56	54	54	51	45
HWP 118	HIGH	58	<b>69</b>	68	65	65	65	62	61
	MED	52	<b>63</b>	62	59	59	59	55	53
	LOW	47	<b>58</b>	58	54	55	54	49	46
HWP 142	HIGH	60	<b>71</b>	70	68	67	66	64	62
	MED	57	<b>68</b>	67	65	65	62	61	58
	LOW	48	<b>59</b>	59	56	59	53	50	45
HWP 172	HIGH	62	<b>73</b>	70	70	69	69	66	64
	MED	57	<b>68</b>	66	65	65	64	60	57
	LOW	52	<b>63</b>	62	61	62	57	55	51

# Water Cooled air conditioners

## Performance Data



### SOUND LEVELS

**Test Conditions:**

SWL measured to BS 848 PT2 1985. Installation Type A (free inlet and outlet). Direct method of measurement (reverberant room). Measured in decibels re 1 picowatt.

### Sound Power Levels (SWL)

SPL measured 1m from source in an anechoic chamber.

### SUPPLY AIR OUTLET

Model	FAN SPEED	SOUND PRESSURE LEVEL SPL dB(A)	SOUND POWER LEVEL SWL dB(A)	OCTAVE BAND FREQUENCY Hz					
				125	250	500	1K	2K	4K
				SOUND POWER LEVELS (SWL) dB					
HWP 192	HIGH	61	<b>72</b>	72	70	68	67	64	62
	MED	54	<b>65</b>	66	62	63	60	57	54
	LOW	50	<b>61</b>	60	57	61	54	50	45
HWP 255	HIGH	64	<b>75</b>	76	72	70	70	67	65
	MED	56	<b>67</b>	70	64	65	61	59	56
	LOW	50	<b>61</b>	65	58	59	55	52	48
HWP 275	HIGH	67	<b>78</b>	77	75	73	73	70	69
	MED	64	<b>75</b>	76	73	71	71	68	66
	LOW	58	<b>69</b>	72	65	66	64	60	58

# Water Cooled air conditioners

## Performance Data



### SUPPLY AIR OUTLET + INSULATED DUCT

Model	FAN SPEED	SOUND PRESSURE LEVEL SPL dB(A)	SOUND POWER LEVEL SWL dB(A)	OCTAVE BAND FREQUENCY Hz					
				125	250	500	1K	2K	4K
				SOUND POWER LEVELS (SWL) dB					
HWP 36	HIGH	40	<b>51</b>	54	52	46	46	43	39
	MED	38	<b>49</b>	53	49	45	44	40	37
	LOW	37	<b>48</b>	53	49	44	43	39	36
HWP 48	HIGH	40	<b>51</b>	54	52	46	46	43	39
	MED	38	<b>49</b>	53	49	45	44	40	37
	LOW	37	<b>48</b>	53	49	44	43	39	36
HWP 59	HIGH	45	<b>56</b>	57	53	52	51	49	44
	MED	43	<b>54</b>	57	52	50	50	47	41
	MED/LOW	43	<b>54</b>	57	51	50	50	47	41
	LOW	41	<b>52</b>	57	50	48	48	45	39
HWP 79	HIGH	45	<b>56</b>	57	53	52	51	49	44
	MED	43	<b>54</b>	57	52	50	50	47	41
	MED/LOW	43	<b>54</b>	57	51	50	50	47	41
	LOW	41	<b>52</b>	57	50	48	48	45	39
HWP 98	HIGH	45	<b>56</b>	57	53	52	51	49	44
	MED	43	<b>54</b>	57	52	50	50	47	41
	MED/LOW	43	<b>54</b>	58	51	50	50	47	41
	LOW	41	<b>52</b>	57	50	48	48	45	39
HWP 118	HIGH	48	<b>59</b>	58	55	55	55	52	51
	MED	43	<b>54</b>	53	50	50	50	46	44
	LOW	41	<b>52</b>	52	48	49	48	43	40
HWP 142	HIGH	50	<b>61</b>	60	58	57	56	54	52
	MED	48	<b>53</b>	58	56	56	53	52	49
	LOW	42	<b>53</b>	53	50	53	47	44	39
HWP 172	HIGH	52	<b>63</b>	60	60	59	59	56	54
	MED	48	<b>59</b>	57	56	56	55	51	48
	LOW	46	<b>57</b>	56	55	56	51	49	45
HWP 192	HIGH	51	<b>62</b>	62	60	58	57	54	52
	MED	45	<b>56</b>	57	53	54	51	48	45
	LOW	44	<b>55</b>	54	51	55	48	44	39

# Water Cooled air conditioners

## Performance Data



### SUPPLY AIR OUTLET + INSULATED DUCT

Model	FAN SPEED	SOUND PRESSURE LEVEL SPL dB(A)	SOUND POWER LEVEL SWL dB(A)	OCTAVE BAND FREQUENCY Hz					
				125	250	500	1K	2K	4K
				SOUND POWER LEVELS (SWL) dB					
HWP 255	HIGH	54	<b>65</b>	66	62	60	60	57	55
	MED	47	<b>58</b>	61	55	56	52	50	47
	LOW	44	<b>55</b>	59	52	53	49	46	42
HWP 275	HIGH	57	<b>68</b>	67	64	63	62	59	58
	MED	55	<b>66</b>	67	64	62	62	59	57
	LOW	52	<b>63</b>	66	59	60	58	54	52

# Water Cooled air conditioners

## Performance Data



### CASE BREAKOUT + RETURN AIR

Model	FAN SPEED	SOUND PRESSURE LEVEL SPL dB(A)	SOUND POWER LEVEL SWL dB(A)	OCTAVE BAND FREQUENCY Hz					
				125	250	500	1K	2K	4K
				SOUND POWER LEVELS (SWL) dB					
HWP 36	HIGH	50	<b>61</b>	69	64	57	54	52	48
	MED	47	<b>58</b>	67	61	54	51	48	45
	LOW	44	<b>55</b>	63	58	51	47	45	40
HWP 48	HIGH	50	<b>61</b>	69	64	57	54	52	48
	MED	47	<b>58</b>	67	61	54	51	48	45
	LOW	44	<b>55</b>	63	58	51	47	45	40
HWP 59	HIGH	53	<b>64</b>	69	63	61	59	57	50
	MED	50	<b>61</b>	67	60	59	56	53	47
	MED/LOW	49	<b>60</b>	66	59	59	55	51	46
	LOW	48	<b>59</b>	65	58	57	53	49	44
HWP 79	HIGH	53	<b>64</b>	69	63	61	59	57	50
	MED	50	<b>61</b>	67	60	59	56	53	47
	MED/LOW	49	<b>60</b>	66	59	59	55	51	46
	LOW	47	<b>58</b>	65	58	57	53	49	44
HWP 98	HIGH	53	<b>64</b>	69	63	61	59	57	50
	MED	50	<b>61</b>	67	60	59	56	53	47
	MED/LOW	49	<b>60</b>	66	59	59	55	51	46
	LOW	47	<b>58</b>	65	58	57	53	49	44
HWP 118	HIGH	54	<b>65</b>	68	63	62	60	57	53
	MED	49	<b>60</b>	65	58	58	55	51	46
	LOW	47	<b>58</b>	63	54	57	52	47	42
HWP 142	HIGH	56	<b>67</b>	69	67	65	62	58	54
	MED	53	<b>64</b>	68	64	62	58	55	50
	LOW	47	<b>58</b>	62	57	59	51	47	42
HWP 172	HIGH	61	<b>72</b>	76	73	68	67	64	60
	MED	56	<b>67</b>	72	67	64	61	58	55
	LOW	53	<b>64</b>	69	63	63	58	54	50
HWP 192	HIGH	57	<b>69</b>	73	69	64	63	61	57
	MED	52	<b>63</b>	66	62	60	58	54	50
	LOW	50	<b>61</b>	61	57	59	53	50	54

# Water Cooled air conditioners

## Performance Data



### CASE BREAKOUT + RETURN AIR

Model	FAN SPEED	SOUND PRESSURE LEVEL SPL dB(A)	SOUND POWER LEVEL SWL dB(A)	OCTAVE BAND FREQUENCY Hz					
				125	250	500	1K	2K	4K
				SOUND POWER LEVELS (SWL) dB					
HWP 255	HIGH	59	<b>70</b>	75	69	66	64	61	59
	MED	52	<b>63</b>	70	62	62	57	54	50
	LOW	49	<b>60</b>	66	58	60	52	49	46
HWP 275	HIGH	62	<b>73</b>	78	72	70	69	64	62
	MED	60	<b>71</b>	76	70	68	66	62	59
	LOW	54	<b>65</b>	71	63	64	59	55	51

# Water Cooled air conditioners

## Performance Data



### SOUND PRESSURE LEVELS (SPL) WITHIN A ROOM

Deduct the room absorption effect below from Sound Power Levels (SWL) to obtain Sound Pressure Levels within a room.



**Note:** Occupant at least 1.5 m from sound source.

Room type	OCTAVE BAND FREQUENCY Hz					
	125	250	500	1K	2K	4K
Soft	4	8	11	11	11	11
Medium	3	7	8	9	9	9
Hard	0	1	3	4	4	5

### RECOMMENDATIONS FOR NOISE ISOLATION

#### Particularly for high static installations:

1. Avoid installing units, with non-ducted return air, directly above spaces where noise is critical.
2. Use flexible connections between unit and rigid ducting.
3. Use generously sized acoustically lined ducts.
4. If generous duct size is not possible, use turning vanes on bends to reduce air turbulence (regenerated noise).
5. Use 90° bends in ducting to significantly assist in noise reduction.

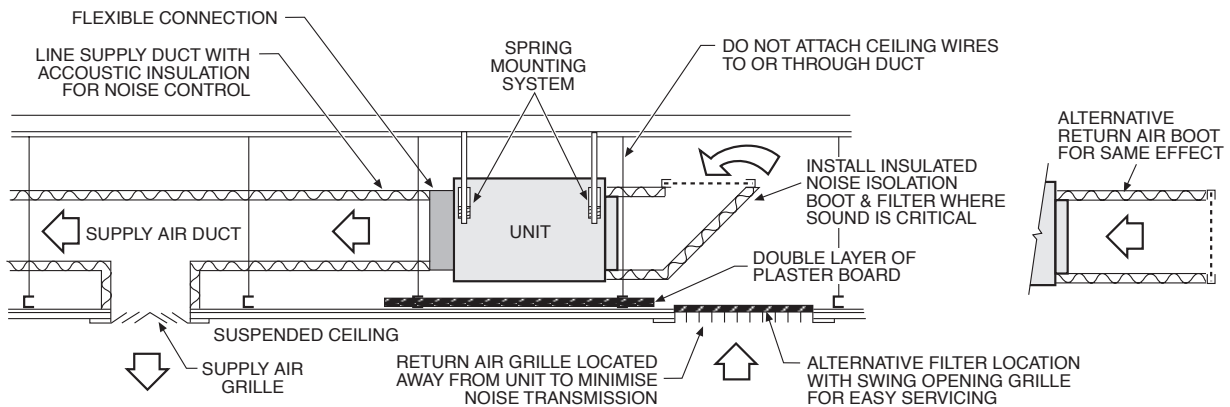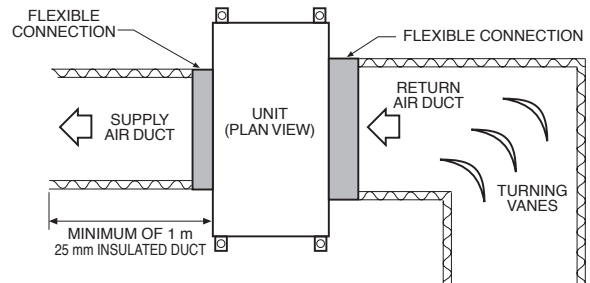

# Water Cooled air conditioners



## Dimensions (mm)





### HWP 36-98

Model	A	B	C	D	D1	E	E1	F	G	H	J	K	L	M	N	O	P	Q	R	S	T
HWP 36	928	355	788	477	451	275	249	517	270	676	864	92	72	34	69	37	180	105	46	90	1/2"
HWP 48	928	355	788	477	451	275	249	517	270	676	864	92	72	34	69	37	180	105	46	90	1/2"
HWP 59	1255	355	788	803	778	275	249	844	270	675	1191	92	72	34	69	37	180	105	46	90	1/2"
HWP 79	1213	415	721	737	711	202	176	697	334	612	1146	72	92	47	67	28	230	112	75	41	3/4"
HWP 98	1213	415	721	737	711	202	176	697	334	612	1146	72	92	47	67	28	220	120	63	89	3/4"

Standard Hand model shown here; refer Specifications sheet for Opposite Hand model.

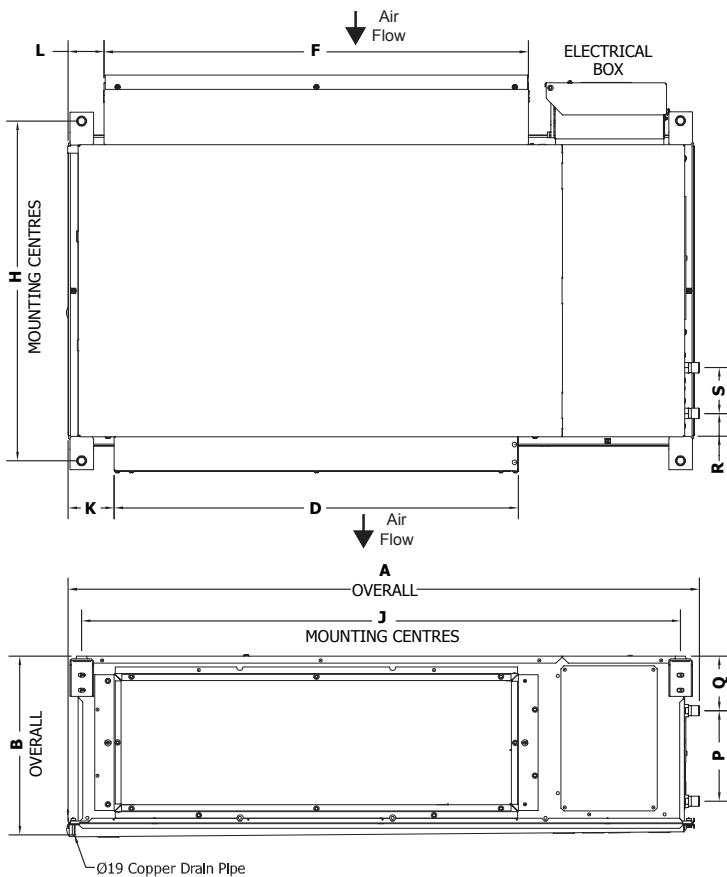

Filter access is via either side of the return air spigot

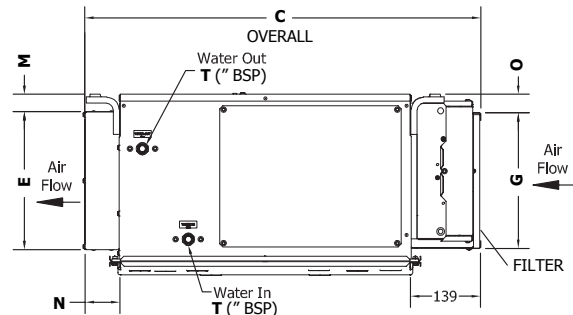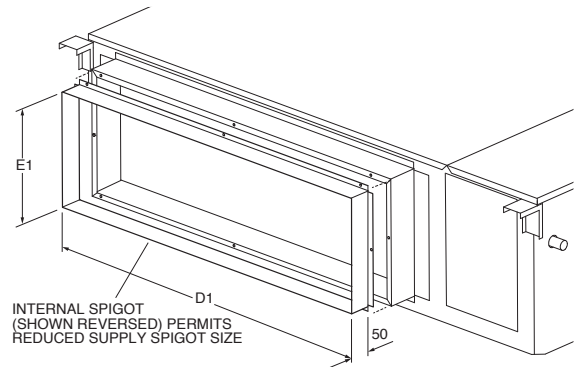

NOT TO SCALE

Materials and specifications are subject to change without notice due to the manufacturer's ongoing research and development programme.



# Water Cooled air conditioners



## Dimensions (mm)





### HWP 118-275

Model	A	B	C	D	D1	E	E1	F	G	H	J	K	L	M	N	O	P	Q	R	S	T
HWP 118	1283	425	721	807	781	247	221	766	334	612	1216	72	92	47	67	38	220	130	63	89	3/4"
HWP 142	1283	507	771	807	781	262	237	767	410	662	1216	72	92	52	67	43	220	212	63	89	3/4"
HWP 172	1513	507	771	1007	981	262	237	967	410	662	1441	72	92	52	67	43	230	204	49	207	1"
HWP 192	1763	507	771	1207	1181	262	237	1167	410	662	1691	72	92	52	67	43	220	202	78	115	1"
HWP 255	1998	507	771	1442	1416	262	237	1402	410	662	1926	72	92	79	67	43	220	202	78	115	1"
HWP 275	2198	507	771	1642	1616	262	237	1602	410	662	2126	72	92	79	67	43	220	202	78	115	1"

Standard Hand model shown here; refer Specifications sheet for Opposite Hand model.

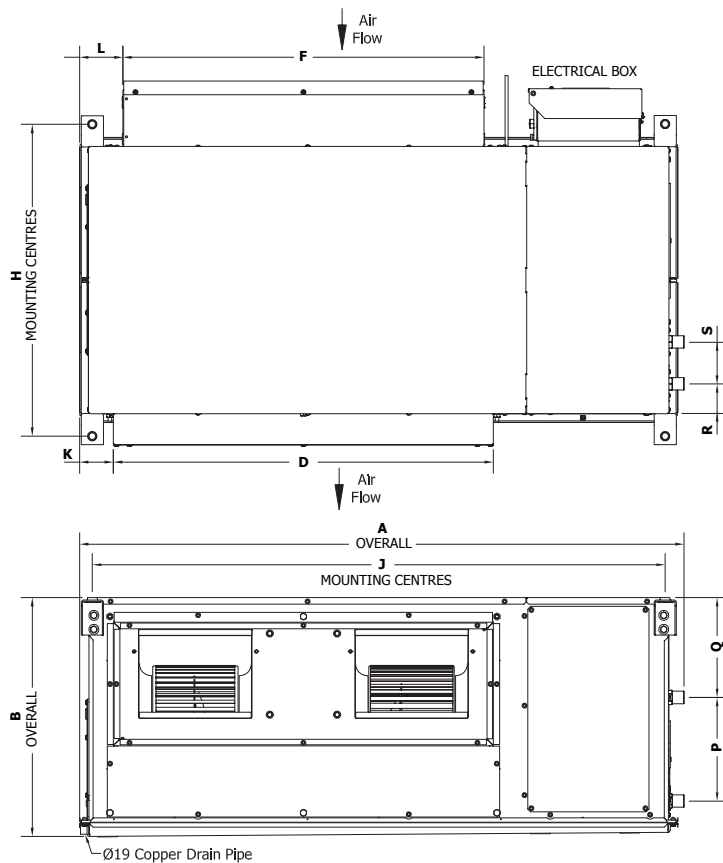

Filter access is via either side of the return air spigot

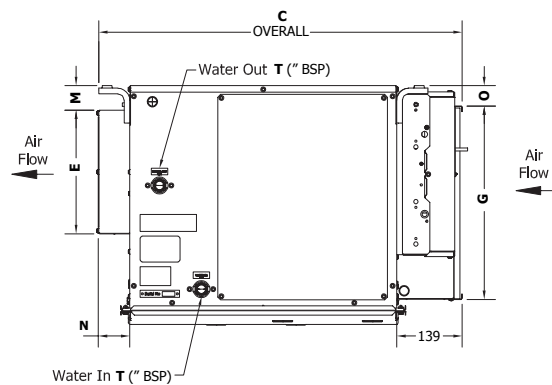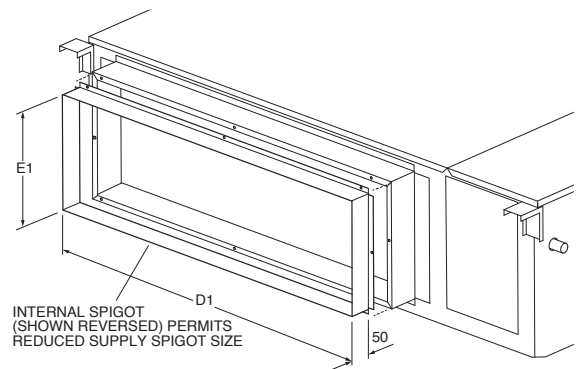

NOT TO SCALE

Materials and specifications are subject to change without notice due to the manufacturer's ongoing research and development programme.

# Water Cooled air conditioners

## Specifications



Model	HWP 36	HWP 48	HWP 59	HWP 79	HWP 98
Nominal Cooling Capacity * <sup>1</sup> kW	3.5	4.4	5.9	8.1	9.9
Net Cooling Capacity (MEPS) kW	3.4	4.3	5.8	7.9	9.8
EER / AEER (cooling) * <sup>8</sup>	3.64 / 3.61	3.64 / 3.62	3.61 / 3.60	3.71 / 3.70	3.77 / 3.76
Heating Capacity * <sup>2</sup> kW	3.6	4.6	5.4	8.9	11.1
COP / ACOP (heating)	3.82 / 3.79	3.66 / 3.64	3.62 / 3.61	4.18 / 4.16	4.22 / 4.21
Electric Heat Option HWP-CE kW	2	2	3	4	4
Air Flow * <sup>3</sup> l/s	190	230	320	500	560
Power Source * <sup>4</sup>	1 phase 230V a.c. 50 Hz				
HWP*R or *C version					
Running Current * <sup>1</sup> A	4.2	5.2	7.6	9.1	11.5
Max. Running Current A	6.2	8.1	11.2	13.1	16.3
HWP*CE version					
Running Current * <sup>1</sup> A	9.4	9.5	14.1	18.8	19.1
Max. Running Current A	10.1	10.1	14.9	19.2	19.2
Refrigerant	R410A				
Nominal Water Flow * <sup>5</sup> l/s	0.22	0.28	0.34	0.50	0.61
Minimum Water Flow * <sup>6</sup> l/s	0.06	0.07	0.09	0.14	0.18
Water Coil Pressure Drop* <sup>7</sup> kPa (psi)	27.6 (4)	27.6 (4)	41 (6)	70 (10)	41 (6)
Unit Controller	UC8				
Filter (EU2/G2 rated)	supplied				
Weight (net) kg	70	70	85	102	112
Weight - incl. water kg	71	71	86	103	113

\*<sup>1</sup>Nominal Cooling Capacity at AS/NZS 3823.1.3 conditions:

Entering Water Temperature 30°C;  
Entering Air Temperature 27°C D.B., 19°C W.B.

\*<sup>2</sup>Heating Capacity (HWP\*R version only) at AS/NZS 3823.1.3 conditions:

Entering Water Temperature 21°C;  
Entering Air Temperature 21°C D.B.

\*<sup>3</sup>Air flows at nominal conditions above.

\*<sup>4</sup> Voltage fluctuation limits: Single phase systems 200–252 V; Three phase systems 342–436 V

\*<sup>5</sup>Nominal water flow at EWT - LWT = 5k.

\*<sup>6</sup>At nominal Entering Water Temperature: 30°C on cooling, 21°C on heating.

\*<sup>7</sup>At nominal water flow.

\*<sup>8</sup>HWP-R version in Cooling mode.

# Water Cooled air conditioners

## Specifications



Model	HWP 118	HWP 142	HWP 172	HWP 192	HWP 255	HWP 275
Nominal Cooling Capacity * <sup>1</sup> kW	12.2	14.7	18.5	21.2	25.5	27.5
Net Cooling Capacity (MEPS) kW	11.9	14.1	17.4	19.9	24.7	26.9
EER / AEER (cooling) * <sup>8</sup>	3.84 / 3.83	3.80 / 3.79	4.24 / 4.22	4.11 / 4.09	4.29 / 4.28	4.23 / 4.22
Heating Capacity * <sup>2</sup> kW	11.9	14.8	16.4	18.6	23.0	24.6
COP / ACOP (rev. cycle heating)	3.80 / 3.79	4.10 / 4.09	4.10 / 4.09	4.23 / 4.21	4.31 / 4.30	4.13 / 4.12
Electric Heat Option HWP*CE kW	6	6	9	9	12	12
Air Flow * <sup>3</sup> l/s	620	775	1015	1160	1220	1400
Power Source * <sup>4</sup>	3 phase 400V					
HWP*R or *C version						
Running Current * <sup>1</sup> A	6.1/3.7/4.2	7.9/4.6/4.5	10.2/6.0/5.9	12/7/7	13.5/8/8	15/9.5/9.5
Max. Running Current A	8.9/6.3/6.3	11.1/7.2/7.2	13.1/8.8/8.5	16/10.8/10.8	18.5/13/13	21/13.5/13
HWP*CE version						
Running Current (heating) A	2.6/13/13	3.5/13/13	17.8/13/13	18.6/13/13	23/17.5/17.5	24/17.5/17.5
Max. Running Current A	8.9/13/13	12/13/13	18.0/13/13	19.0/13/13	24/17.5/17.5	25/17.5/17.5
Refrigerant	R410A					
Nominal Water Flow * <sup>5</sup> l/s	0.75	0.88	1.06	1.26	1.53	1.63
Minimum Water Flow * <sup>6</sup> l/s	0.21	0.24	0.30	0.35	0.42	0.46
Water Coil Pressure Drop* <sup>7</sup> kPa (psi)	55 (8)	69 (10)	83 (12)	34 (5)	48 (7)	55 (8)
Unit Controller	UC8					
Filter (EU2/G2 rated)	supplied					
Weight (net) kg	117	141	153	177	190	199
Weight - incl. water kg	118	142	154	179	192	201

\*<sup>1</sup>Nominal Cooling Capacity at AS/NZS 3823.1.3 conditions:

Entering Water Temperature 30°C;  
Entering Air Temperature 27°C D.B., 19°C W.B.

\*<sup>2</sup>Heating Capacity (HWP\*R version only) at AS/NZS 3823.1.3 conditions:

Entering Water Temperature 20°C;  
Entering Air Temperature 20°C D.B.

\*<sup>3</sup>Air flows at nominal conditions above.

\*<sup>4</sup> Voltage fluctuation limits: Single phase systems 200–252 V; Three phase systems 342–436 V

\*<sup>5</sup>Nominal water flow at EWT - LWT = 5k.

\*<sup>6</sup>At nominal Entering Water Temperature: 30°C on cooling, 20°C on heating.

\*<sup>7</sup>At nominal water flow.

\*<sup>8</sup>HWP-R version in Cooling mode.



---

www.temperzone.biz

---

**AUCKLAND**

**Head Office**

38 Tidal Rd, Mangere, N.Z.  
Private Bag 93303, Otahuhu,  
NEW ZEALAND.

Email [sales@temperzone.co.nz](mailto:sales@temperzone.co.nz)

Phone (09) 279 5250

Fax (09) 275 5637

**SYDNEY**

**Head Office**

14 Carnegie Place, Blacktown,  
NSW 2148  
PO Box 8064, Seven Hills West,  
NSW 2147, AUSTRALIA.

Email [sales@temperzone.com.au](mailto:sales@temperzone.com.au)

Phone (02) 8822 - 5700

Fax (02) 8822 - 5711

**NEWCASTLE**

Phone (02) 4962 - 1155

Fax (02) 4961 - 5101

**LAUNCESTON**

Phone (03) 6331 - 4209

Fax (03) 6333 - 0224

**WELLINGTON**

Phone (04) 569 3262

Fax (04) 566 6249

**ADELAIDE**

Phone (08) 8115 - 2111

Fax (08) 8115 - 2118

**JAKARTA**

Phone +62 (21) 2963 4983

Fax +62 (21) 2963 4984

**CHRISTCHURCH**

Phone (03) 379 3216

Fax (03) 379 5956

**MELBOURNE**

Phone (03) 8769 - 7600

Fax (03) 8769 - 7601

**SINGAPORE**

Phone +65 6733 4292

Fax +65 6235 7180

**BRISBANE**

Phone (07) 3308 - 8333 or  
1800 - 897 - 253

Fax (07) 3308 - 8330

**PERTH**

Phone (08) 6399 - 5900

Fax (08) 6399 - 5932



Available from