

Model	OPA 450RLTFPQ-S3
Configuration	Horizontal Supply Air
Item No. (Standard / Opposite Hand)	876-045-701 / 876-045-710
Unit c/w Fresh Air Cowl (OPA 450RLTFPQ-C)	878-045-701 / 878-045-710
Configuration	Downward Supply Air
Item No. (Standard / Opposite Hand)	876-045-723 / 876-045-732
Unit c/w Fresh Air Cowl (OPA 450RLTFPQ-C)	878-045-723 / 878-045-732
Cooling capacity (net) *	43.3 kW
Cooling capacity range (gross)	18.2 ~ 52.4 kW
Heating capacity *	44.4 kW
Heating capacity range	16.5 ~ 54.5 kW
Electrical input - cooling	14.5 kW
Electrical input - heating	14.2 kW
EER / AEER (cooling)*	2.99 / 2.98
COP / ACOP (heating) *	3.14 / 3.13
Unit Controller	UC8
Refrigerant	R32
Refrigerant Charge	10.5 kg
Minimum floor area (@2.4m below ceiling diffuser)	58.6 m ²
Compressor oil type	POE-46 (NXG5020 or equivalent)
Compressor type	inverter scroll
Power supply **	3 ph. 400 V ac 50 Hz + N + E
Compressor (3ph.) run amps *	19.5 A/ph.
Compressor + VSD circuit breaker	50 A
Indoor fan motor size	EC plug 500 dia. 3.58kW
Nominal air flow *	2,200 l/s
Indoor fan motor (3ph.) - full load	5.5 A/ph.
Outdoor fan motor (3ph.) - full load	4.2 A/ph.
Outdoor fan type	EC axial
Outdoor fan max. static pressure @ 5500 l/s	190 Pa
Control circuit breaker (internal)	2 A
Auxiliary power outlet (1ph.) overload setting	10 A
Running amps (total system)*	24 / 22 / 24 A
Max. running amps (total system)	40 A/ph.
RCD type recommended	type B, 30mA, 3 pole
Net weight	643 kg
Shipping Weight	708 kg
Net Weight c/w Fresh Air Cowl option	652 kg

Accessories:

Filters - rated EU4/G4 disposable	019-400-004 500x500x50 (x4)
Filters - rated EU4/G4 washable	019-000-033 500x500x50 (x4)
Drain tundish (set of 2)	060-000-653

Optional Controls:

Climate Touch CTC-1 Room temp. controller	201-000-792
TZT-100 Room temperature controller	201-000-350

Refer to temperzone for other options.

* Tested in accordance with AS/NZS 3823

** Voltage range: 376-440V


20053

DIMENSIONS (mm)






Not to Scale

OPA 450RLTFP01(-C)-S3 Standard Hand, Horizontal Supply





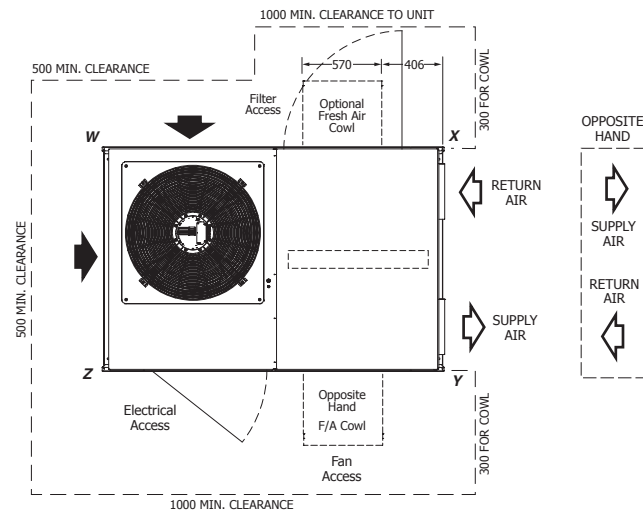


		POINT LOADS (kg)			
		W	X	Y	Z
Std Hd	no F/A	134	170	134	205
	cw F/A	134	179	134	205
Op Hd	no F/A	148	173	133	189

Multiple units side-by-side:
Allow a minimum of 1m
between coil faces.

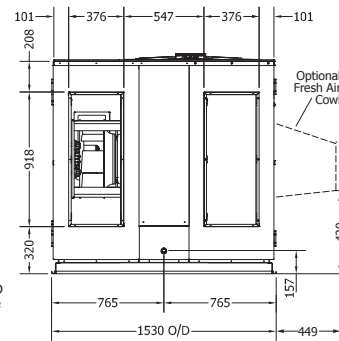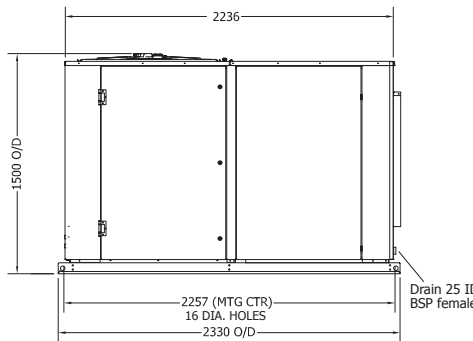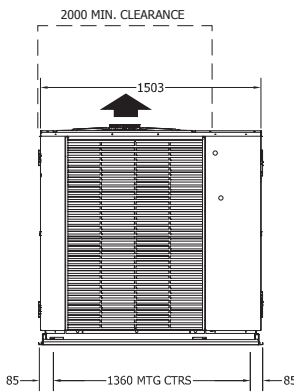


OPA 450RLTFP23(-C)-S3 Standard Hand, Downward Supply

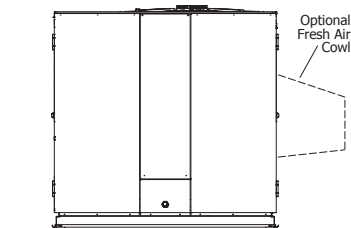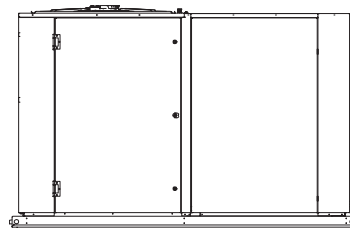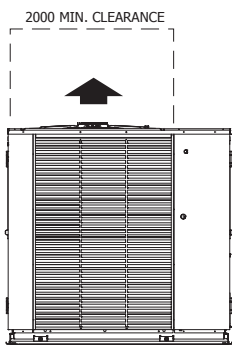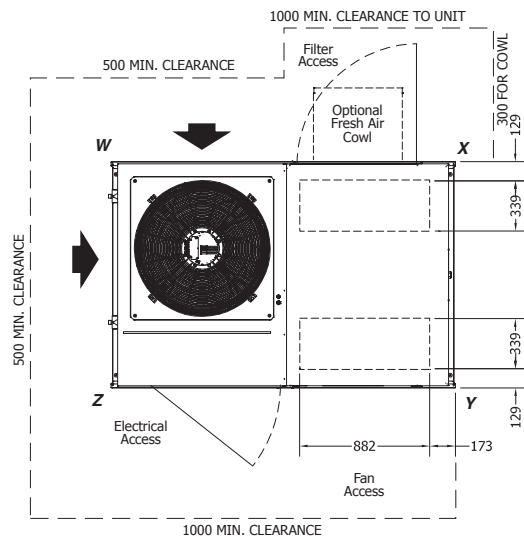

NOTE

Specifications are subject to change without notice due to the manufacturer's ongoing research and development programme.

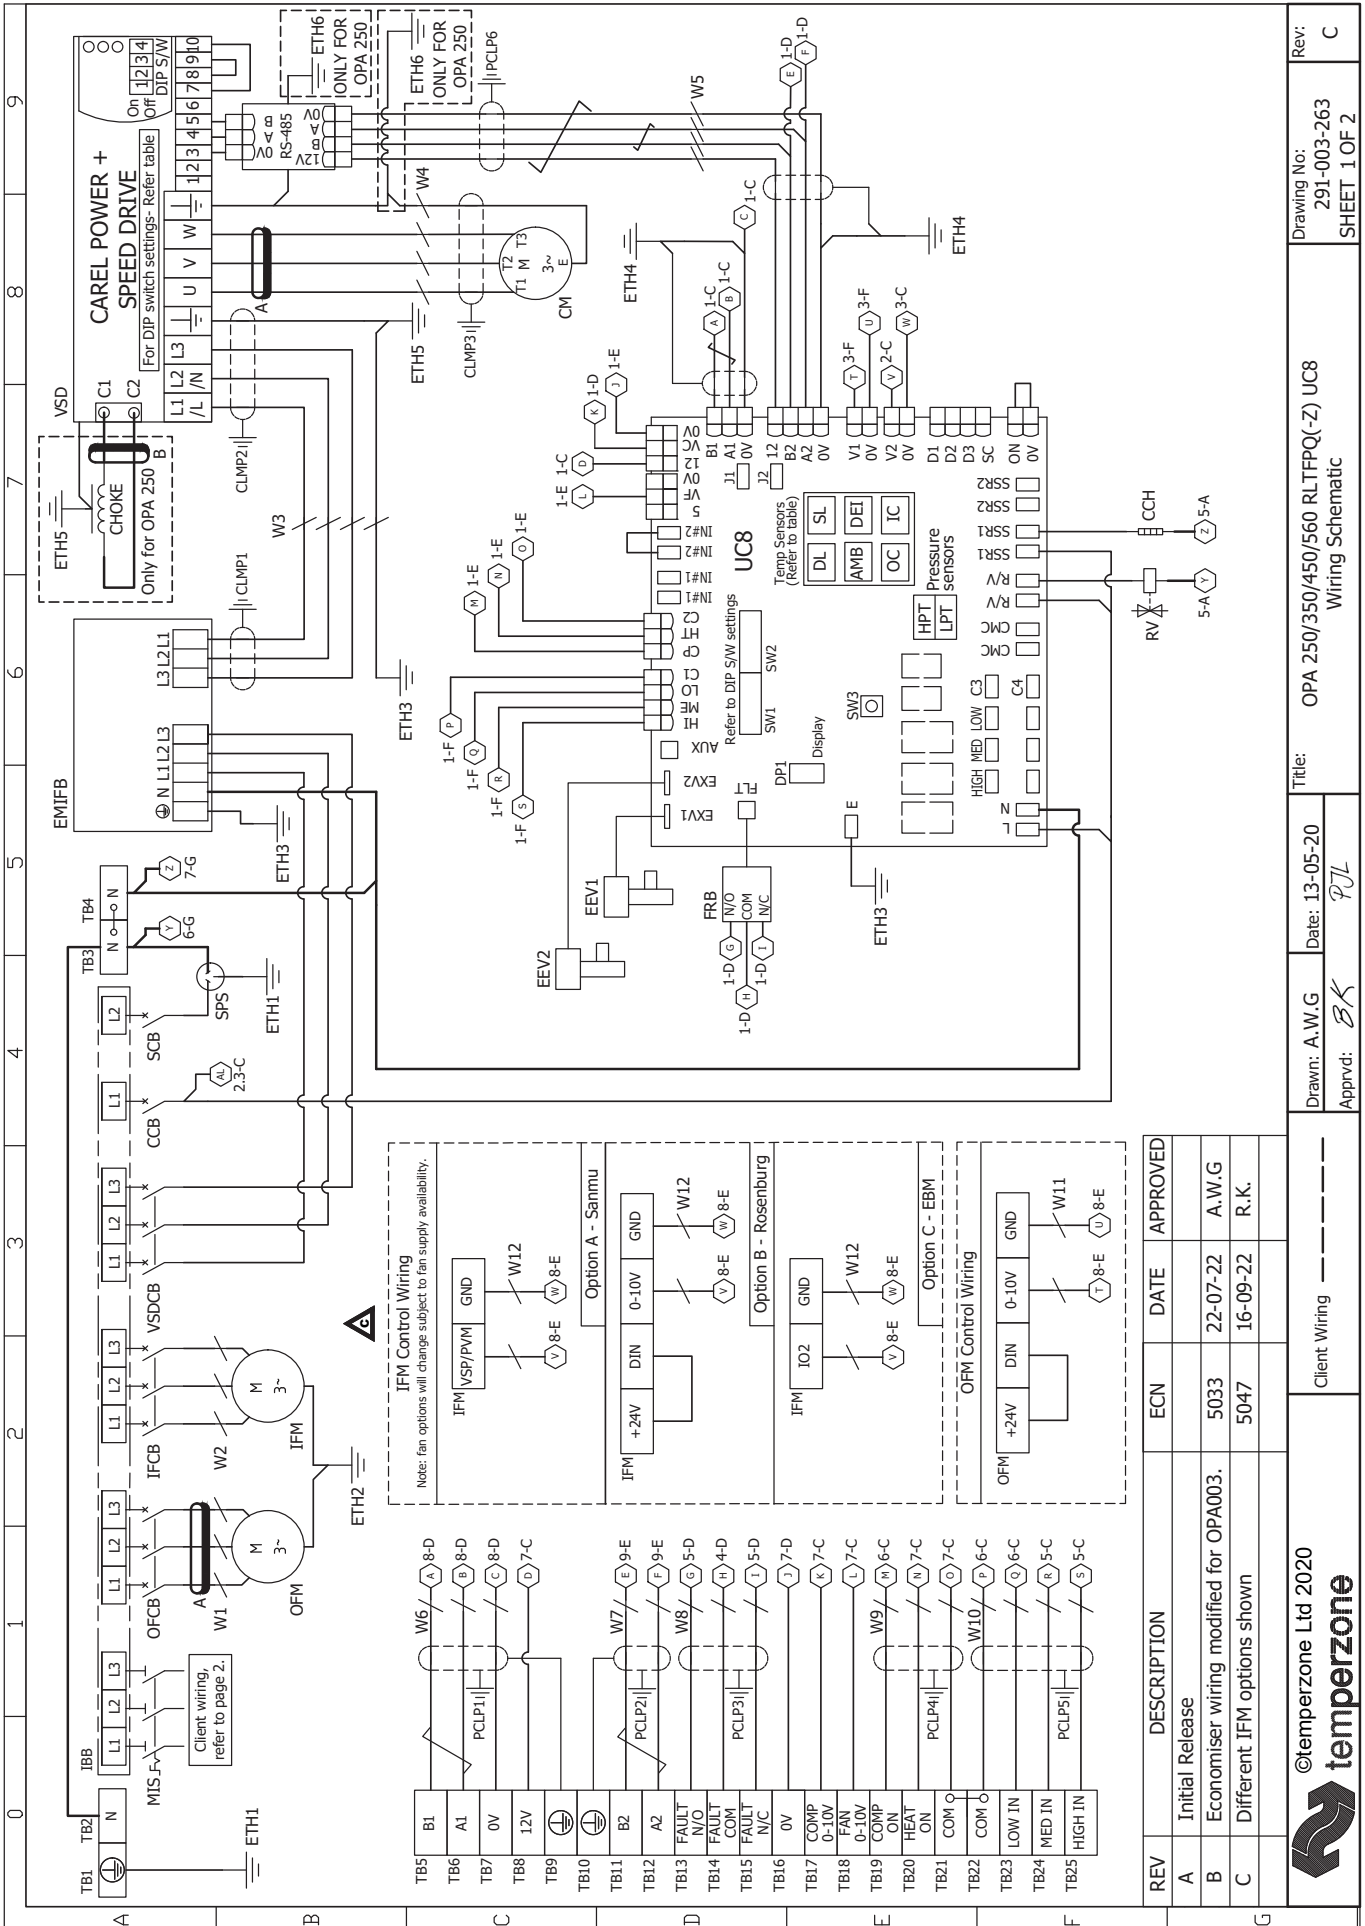

REV	DESCRIPTION	ECN	DATE	APPROVED
A	Initial Release			
B	Economiser wiring modified for OPA003.	5033	22-07-22	A.W.G
C	Different IFM options shown	5047	16-09-22	R.K.

©temperzone Ltd 2020

Drawn: A.W.G	Date: 13-05-20	Client Wiring
Approved: BK	PJL	

Title: OPA 250/350/450/560 RLTFPQ(-Z) UC8
 Wiring Schematic

Drawing No: 291-003-263
 SHEET 1 OF 2
 Rev: C

0	1	2	3	4	5	6	7	8	9																																																																
A	<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;">Client Wiring</p> <p style="text-align: center;">Client External Protection and Isolator Switch</p> </div>		<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;">Customer BMS Input</p> <p style="text-align: center;">Connect cable screen to 'EARTH' terminal</p> </div>		<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;">Ferrites</p> <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>Part Number</th> <th>Frequency Type</th> <th>Number of Turns</th> </tr> <tr> <td>A 012-001-074</td> <td>High</td> <td>1</td> </tr> <tr> <td>B 012-001-094</td> <td>Low</td> <td>1</td> </tr> </table> <p style="text-align: center;">Important Note! Ferrite 'A' on OD Fan circuit breaker for OPA 450 and 560 only.</p> </div>		Part Number	Frequency Type	Number of Turns	A 012-001-074	High	1	B 012-001-094	Low	1	<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;">24VCB</p> <table border="1" style="width:100%; border-collapse: collapse;"> <tr><td>24VCB</td><td>24 Volt Circuit Breaker</td></tr> <tr><td>CCB</td><td>Control Circuit Breaker</td></tr> <tr><td>CCH</td><td>Crankcase Heater</td></tr> <tr><td>CM</td><td>Compressor Motor</td></tr> <tr><td>DMF</td><td>Damper Motor Fresh Air</td></tr> <tr><td>DMR</td><td>Damper Motor Return Air</td></tr> <tr><td>EEV</td><td>Electronic Expansion Valve</td></tr> <tr><td>EMIFB</td><td>EMI Filter Board</td></tr> <tr><td>ETH</td><td>Earth</td></tr> <tr><td>FRB</td><td>Fault Relay Board</td></tr> <tr><td>IFCB</td><td>Indoor Fan Circuit Breaker</td></tr> <tr><td>IFM</td><td>Indoor Fan Motor</td></tr> <tr><td>IBB</td><td>Insulated Bus Bar</td></tr> <tr><td>MIS</td><td>Main Isolator Switch</td></tr> <tr><td>OFCB</td><td>Outdoor Fan Circuit Breaker</td></tr> <tr><td>OFM</td><td>Outdoor Fan Motor</td></tr> <tr><td>PCLP</td><td>P Clip</td></tr> <tr><td>RV</td><td>Reversing Valve</td></tr> <tr><td>SCB</td><td>Socket Circuit Breaker</td></tr> <tr><td>SPS</td><td>Single Phase Socket</td></tr> <tr><td>TB</td><td>Terminal Block</td></tr> <tr><td>TR</td><td>Transformer</td></tr> <tr><td>UC8</td><td>Unit Controller 8</td></tr> <tr><td>VSD</td><td>Variable Speed Drive</td></tr> <tr><td>VSDCB</td><td>Variable Speed Drive Circuit Breaker</td></tr> <tr><td>W</td><td>Cable Marker</td></tr> </table> </div>		24VCB	24 Volt Circuit Breaker	CCB	Control Circuit Breaker	CCH	Crankcase Heater	CM	Compressor Motor	DMF	Damper Motor Fresh Air	DMR	Damper Motor Return Air	EEV	Electronic Expansion Valve	EMIFB	EMI Filter Board	ETH	Earth	FRB	Fault Relay Board	IFCB	Indoor Fan Circuit Breaker	IFM	Indoor Fan Motor	IBB	Insulated Bus Bar	MIS	Main Isolator Switch	OFCB	Outdoor Fan Circuit Breaker	OFM	Outdoor Fan Motor	PCLP	P Clip	RV	Reversing Valve	SCB	Socket Circuit Breaker	SPS	Single Phase Socket	TB	Terminal Block	TR	Transformer	UC8	Unit Controller 8	VSD	Variable Speed Drive	VSDCB	Variable Speed Drive Circuit Breaker	W	Cable Marker	<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;">Economiser Option</p> </div>		<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;">Important Note! Unit requires 24 hour power supply for control circuit and crankcase heaters</p> </div>	
Part Number	Frequency Type	Number of Turns																																																																							
A 012-001-074	High	1																																																																							
B 012-001-094	Low	1																																																																							
24VCB	24 Volt Circuit Breaker																																																																								
CCB	Control Circuit Breaker																																																																								
CCH	Crankcase Heater																																																																								
CM	Compressor Motor																																																																								
DMF	Damper Motor Fresh Air																																																																								
DMR	Damper Motor Return Air																																																																								
EEV	Electronic Expansion Valve																																																																								
EMIFB	EMI Filter Board																																																																								
ETH	Earth																																																																								
FRB	Fault Relay Board																																																																								
IFCB	Indoor Fan Circuit Breaker																																																																								
IFM	Indoor Fan Motor																																																																								
IBB	Insulated Bus Bar																																																																								
MIS	Main Isolator Switch																																																																								
OFCB	Outdoor Fan Circuit Breaker																																																																								
OFM	Outdoor Fan Motor																																																																								
PCLP	P Clip																																																																								
RV	Reversing Valve																																																																								
SCB	Socket Circuit Breaker																																																																								
SPS	Single Phase Socket																																																																								
TB	Terminal Block																																																																								
TR	Transformer																																																																								
UC8	Unit Controller 8																																																																								
VSD	Variable Speed Drive																																																																								
VSDCB	Variable Speed Drive Circuit Breaker																																																																								
W	Cable Marker																																																																								
B																																																																									
C																																																																									
D																																																																									
E																																																																									
F																																																																									
G																																																																									
			<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>REV</th> <th>DESCRIPTION</th> <th>ECN</th> <th>DATE</th> <th>APPROVED</th> </tr> </thead> <tbody> <tr> <td>A</td> <td>Initial Release</td> <td></td> <td></td> <td></td> </tr> <tr> <td>B</td> <td>Economiser wiring modified for OPA003.</td> <td>5033</td> <td>22-07-22</td> <td>A.W.G</td> </tr> <tr> <td>C</td> <td>Different IFM options shown</td> <td>5047</td> <td>16-09-22</td> <td>R.K.</td> </tr> </tbody> </table>			REV	DESCRIPTION	ECN	DATE	APPROVED	A	Initial Release				B	Economiser wiring modified for OPA003.	5033	22-07-22	A.W.G	C	Different IFM options shown	5047	16-09-22	R.K.	<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">UC8 DIP switch settings</th> <th colspan="2">PSD DIP switch settings</th> </tr> <tr> <th>DIP switch</th> <th>On/Off ↓</th> <th>DIP switch</th> <th>On/Off ↓</th> </tr> </thead> <tbody> <tr> <td>1,2,4,6,7,10,14</td> <td>On</td> <td>1, 4</td> <td>On</td> </tr> <tr> <td>All Others Off</td> <td>Off</td> <td>2, 3</td> <td>Off</td> </tr> </tbody> </table>			UC8 DIP switch settings		PSD DIP switch settings		DIP switch	On/Off ↓	DIP switch	On/Off ↓	1,2,4,6,7,10,14	On	1, 4	On	All Others Off	Off	2, 3	Off																													
REV	DESCRIPTION	ECN	DATE	APPROVED																																																																					
A	Initial Release																																																																								
B	Economiser wiring modified for OPA003.	5033	22-07-22	A.W.G																																																																					
C	Different IFM options shown	5047	16-09-22	R.K.																																																																					
UC8 DIP switch settings		PSD DIP switch settings																																																																							
DIP switch	On/Off ↓	DIP switch	On/Off ↓																																																																						
1,2,4,6,7,10,14	On	1, 4	On																																																																						
All Others Off	Off	2, 3	Off																																																																						
			<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">Sensors (S) / Transducers (T)</th> <th>Name</th> <th>Type</th> <th>Colour</th> </tr> </thead> <tbody> <tr><td>DL</td><td>Discharge Temp</td><td>S</td><td>S</td><td>GREY</td></tr> <tr><td>SL</td><td>Suction Temp</td><td>S</td><td>S</td><td>WHITE</td></tr> <tr><td>AMB</td><td>Ambient Temp</td><td>S</td><td>S</td><td>YELLOW</td></tr> <tr><td>DEI</td><td>De-ice Temp</td><td>S</td><td>S</td><td>BLUE</td></tr> <tr><td>IC</td><td>De-ice Temp</td><td>S</td><td>S</td><td>BLUE</td></tr> <tr><td>LPT</td><td>Suction Pressure</td><td>T</td><td>T</td><td></td></tr> <tr><td>HPT</td><td>High Pressure</td><td>T</td><td>T</td><td></td></tr> </tbody> </table>			Sensors (S) / Transducers (T)		Name	Type	Colour	DL	Discharge Temp	S	S	GREY	SL	Suction Temp	S	S	WHITE	AMB	Ambient Temp	S	S	YELLOW	DEI	De-ice Temp	S	S	BLUE	IC	De-ice Temp	S	S	BLUE	LPT	Suction Pressure	T	T		HPT	High Pressure	T	T		<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">SAT-3 & TZT100 connection to UC8 terminals</th> </tr> </thead> <tbody> <tr> <td>UC8 terminals</td> <td>SAT-3</td> </tr> <tr> <td>12</td> <td>12V</td> </tr> <tr> <td>B2</td> <td>B</td> </tr> <tr> <td>A2</td> <td>A</td> </tr> <tr> <td>0V</td> <td>GND</td> </tr> <tr> <td>Shield to 0V</td> <td>24C</td> </tr> </tbody> </table>			SAT-3 & TZT100 connection to UC8 terminals		UC8 terminals	SAT-3	12	12V	B2	B	A2	A	0V	GND	Shield to 0V	24C											
Sensors (S) / Transducers (T)		Name	Type	Colour																																																																					
DL	Discharge Temp	S	S	GREY																																																																					
SL	Suction Temp	S	S	WHITE																																																																					
AMB	Ambient Temp	S	S	YELLOW																																																																					
DEI	De-ice Temp	S	S	BLUE																																																																					
IC	De-ice Temp	S	S	BLUE																																																																					
LPT	Suction Pressure	T	T																																																																						
HPT	High Pressure	T	T																																																																						
SAT-3 & TZT100 connection to UC8 terminals																																																																									
UC8 terminals	SAT-3																																																																								
12	12V																																																																								
B2	B																																																																								
A2	A																																																																								
0V	GND																																																																								
Shield to 0V	24C																																																																								
			<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">UC8 DIP switch settings</th> <th colspan="2">PSD DIP switch settings</th> </tr> <tr> <th>DIP switch</th> <th>On/Off ↓</th> <th>DIP switch</th> <th>On/Off ↓</th> </tr> </thead> <tbody> <tr> <td>1,2,4,6,7,10,14</td> <td>On</td> <td>1, 4</td> <td>On</td> </tr> <tr> <td>All Others Off</td> <td>Off</td> <td>2, 3</td> <td>Off</td> </tr> </tbody> </table>			UC8 DIP switch settings		PSD DIP switch settings		DIP switch	On/Off ↓	DIP switch	On/Off ↓	1,2,4,6,7,10,14	On	1, 4	On	All Others Off	Off	2, 3	Off	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width: 50%;"> Drawing No: 291-003-263 SHEET 2 OF 2 </td> <td style="width: 50%;"> Rev: C </td> </tr> </table>			Drawing No: 291-003-263 SHEET 2 OF 2	Rev: C																																															
UC8 DIP switch settings		PSD DIP switch settings																																																																							
DIP switch	On/Off ↓	DIP switch	On/Off ↓																																																																						
1,2,4,6,7,10,14	On	1, 4	On																																																																						
All Others Off	Off	2, 3	Off																																																																						
Drawing No: 291-003-263 SHEET 2 OF 2	Rev: C																																																																								
			Title: OPA 250/350/450/560 RLTPFQ(-Z) UC8 Wiring Schematic			Date: 13-05-20			Drawn: A.W.G			Approved: BK																																																													
			Client Wiring			ECN			DATE			APPROVED																																																													
			Client Wiring Ltd 2020			5033			22-07-22			A.W.G																																																													
						5047			16-09-22			R.K.																																																													